

**INFILTRATION BASIN OPERATION AND MAINTENANCE  
AGREEMENT AND SECURITY**

Project Name: \_\_\_\_\_

Project Location: \_\_\_\_\_

SCM as Identified on Approved Plans: \_\_\_\_\_

PIN Number: \_\_\_\_\_

Mail after recording to: City of Burlington  
Water Resources  
P.O. Box 1358  
Burlington, NC 27216

NORTH CAROLINA

ALAMANCE COUNTY

This STORMWATER OPERATION AND MAINTENANCE AGREEMENT,

made this day \_\_\_\_\_ of \_\_\_\_\_, 20 \_\_\_\_\_ by

\_\_\_\_\_ whose principal address is

\_\_\_\_\_ with, to, and for the

benefit of the City of Burlington, a municipal corporation of the State of North Carolina, whose address is P.O. Box 1358, Burlington, North Carolina 27216.

## Infiltration Basin Operation and Maintenance Agreement

I will keep a maintenance record on this Stormwater Control Measure (SCM). This maintenance record will be kept in a log in a known set location. Any deficient SCM elements noted in the inspection will be corrected, repaired or replaced immediately. These deficiencies can affect the integrity of structures, safety of the public, and the removal efficiency of the SCM.

Important maintenance procedures:

- The drainage area will be carefully managed to reduce the sediment load to the infiltration basin.
- Immediately after the infiltration basin is established, the vegetation will be watered twice weekly if needed until the plants become established (commonly six weeks).
- No portion of the infiltration basin will be fertilized after the initial fertilization that is required to establish the vegetation.
- The vegetation in and around the basin will be maintained at a height of approximately six inches.

After the infiltration basin is established, it will be inspected **once a quarter and within 24 hours after every storm event greater than 1.0 inches**. Records of operation and maintenance will be kept in a known set location and will be available upon request. **Annually, by May 31, an inspection shall be completed by a qualified professional and submitted to the City of Burlington.**

Inspection activities shall be performed as follows. Any problems that are found shall be repaired immediately.

SCM element:	Potential problem:	How I will remediate the problem:
<b>The entire SCM</b>	Trash/debris is present.	Remove the trash/debris.
<b>The perimeter of the infiltration basin</b>	Areas of bare soil and/or erosive gullies have formed.	Regrade the soil if necessary to remove the gully, and then plant a ground cover and water until it is established. Provide lime and a one-time fertilizer application.
<b>The inlet device: pipe or swale</b>	The pipe is clogged (if applicable).	Unclog the pipe. Dispose of the sediment off-site.
	The pipe is cracked or otherwise damaged (if applicable).	Replace the pipe.
	Erosion is occurring in the swale (if applicable).	Regrade the swale if necessary to smooth it over and provide erosion control devices such as reinforced turf matting or riprap to avoid future problems with erosion.

<b>SCM element:</b>	<b>Potential problem:</b>	<b>How I will remediate the problem:</b>
<b>The forebay</b>	Sediment has accumulated and reduced the depth to 75% of the original design depth.	Search for the source of the sediment and remedy the problem if possible. Remove the sediment and dispose of it in a location where it will not cause impacts to streams or the SCM.
	Erosion has occurred or riprap is displaced.	Provide additional erosion protection such as reinforced turf matting or riprap if needed to prevent future erosion problems.
	Weeds are present.	Remove the weeds, preferably by hand. If herbicides are used, wipe them on the plants rather than spraying.
<b>The main treatment area</b>	A visible layer of sediment has accumulated.	Search for the source of the sediment and remedy the problem if possible. Remove the sediment and dispose of it in a location where it will not cause impacts to streams or the SCM. Replace any media that was removed in the process. Revegetate disturbed areas immediately.
	Water is standing more than 5 days after a storm event.	Replace the top few inches of filter media and see if this corrects the standing water problem. If so, revegetate immediately. If not, consult an appropriate professional for a more extensive repair.
	Weeds and noxious plants are growing in the main treatment area.	Remove the plants by hand or by wiping them with pesticide (do not spray).
<b>The embankment</b>	Shrubs or trees have started to grow on the embankment.	Remove shrubs or trees immediately.
	An annual inspection by appropriate professional shows that the embankment needs repair.	Make all needed repairs.
<b>The outlet device</b>	Clogging has occurred.	Clean out the outlet device. Dispose of the sediment off-site.
	The outlet device is damaged	Repair or replace the outlet device.
<b>The receiving water</b>	Erosion or other signs of damage have occurred at the outlet.	Contact the City of Burlington Water Resources Stormwater Division at 336-222-5140.

I acknowledge and agree by my signature below that I am responsible for the performance of the maintenance procedures listed above. I agree to notify the City of Burlington of any problems with the system or prior to any changes to the system or responsible party.

This Agreement shall be binding upon the undersigned and its successors and assigns and all current and future owners thereof, and their respective heirs, successors and assigns, in perpetuity, and shall be appurtenant to, run with, and burden the parcels of land referred to herein.

*Project name:* \_\_\_\_\_

*SCM as Identified on Approved Plans:* \_\_\_\_\_

Print name: \_\_\_\_\_

Title: \_\_\_\_\_


Address: \_\_\_\_\_

Phone: \_\_\_\_\_

Signature: \_\_\_\_\_

Date: \_\_\_\_\_

I, \_\_\_\_\_, a Notary Public for the State of \_\_\_\_\_, County of \_\_\_\_\_, do hereby certify that \_\_\_\_\_ personally appeared before me this \_\_\_\_\_ day of \_\_\_\_\_, \_\_\_\_\_, and acknowledge the due execution of the forgoing infiltration basin maintenance requirements. Witness my hand and official seal,

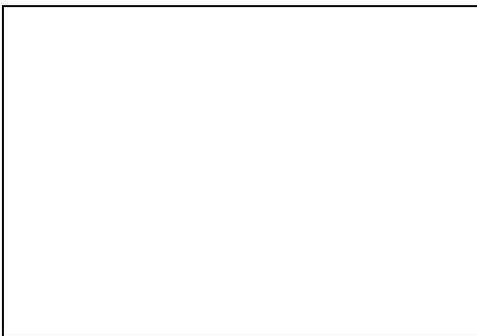

SEAL

My commission expires \_\_\_\_\_