


BOXES SHALL BE AS MANUFACTURED BY QUAZITE COMPOSITE, STAY-RIGHT TANK CO. OR CDR SYSTEMS CORPORATION, PRECAST CONCRETE, CAST IN PLACE CONCRETE, BRICK MASONRY OR OTHER AS APPROVED BY CITY ENGINEER.

CAST IRON FRAME AND COVERS SHALL BE USED IN LIEU OF LID SHOWN AND APPROVED BY CITY ENGINEER.

FOR DIMENSION PURPOSES QUAZITE MODEL NOS. INDICATED - COVER LG3660CA AND STANDARD BOX LG3660BG

SETTER TO BE 2" CUSTOM SETTER WITH BYPASS AND FLANGED VALVE ON INLET AND OUTLET.

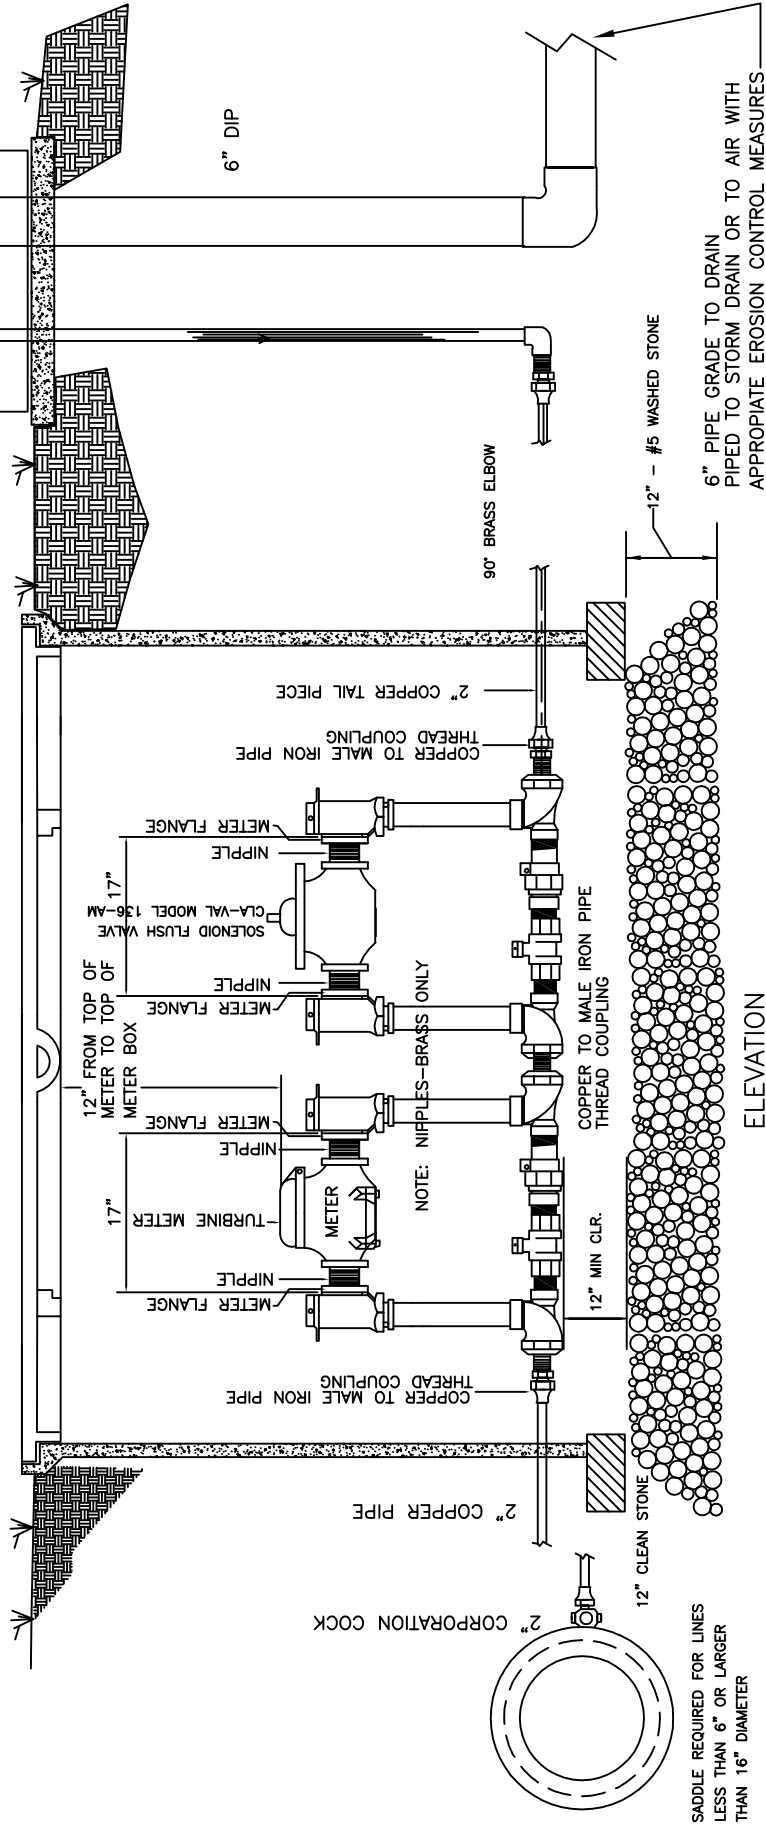

SADDLE REQUIRED FOR LINES LESS THAN 6" OR LARGER THAN 16" DIAMETER



DATE	8/16/04	REVISED	8/18/04	SCALE	NOT TO SCALE
------	---------	---------	---------	-------	--------------

DETAIL	W-5
--------	-----

2 INCH AUTOMATIC FLUSHING ASSEMBLY  
CITY OF BURLINGTON, NORTH CAROLINA  
ENGINEERING DEPARTMENT