


NO ALTERATIONS NOR ADJUSTMENTS TO BE MADE IN THIS AREA WITHOUT APPROVAL OF THE ENGINEER

ALL WORK IN THIS AREA TO BE INSTALLED AS PER PLUMBING CODE

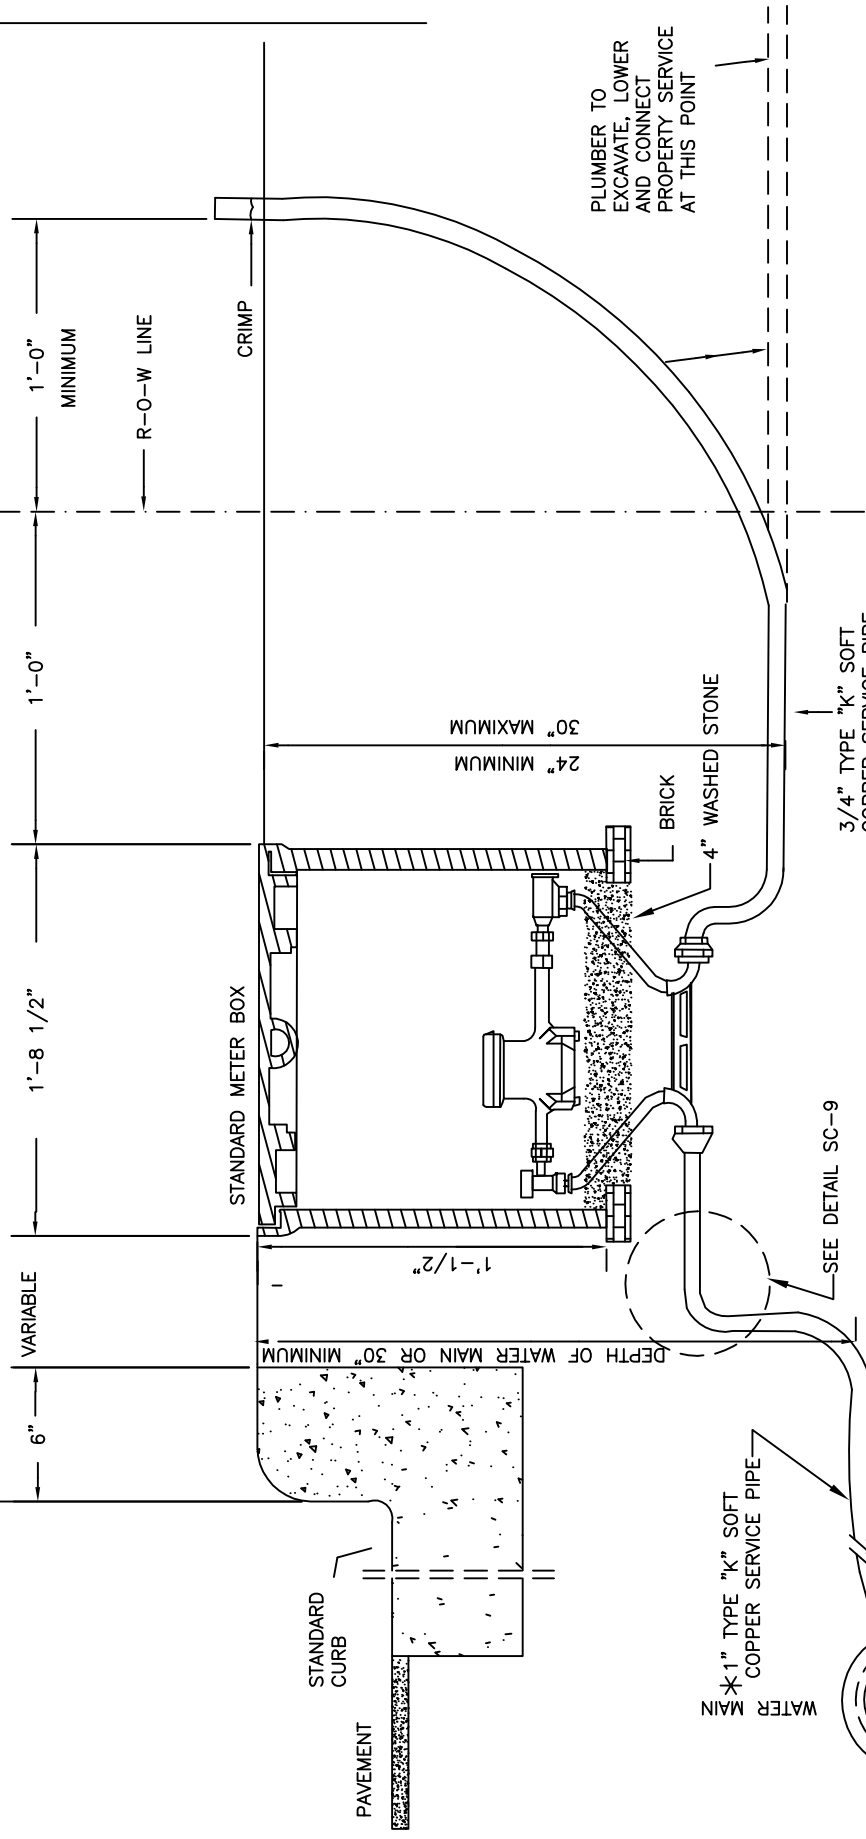

* CORPORATION AND SERVICE PIPE BETWEEN WATER MAIN AND METER BOX SHALL BE 1 INCH DIAMETER UNLESS APPROVED BY THE CITY ENGINEER

DATE	8/16/04	REVISION	10/14/05	SCALE	NOT TO SCALE	DETAIL	SC-10
------	---------	----------	----------	-------	--------------	--------	-------

* 1" AND 3/4" WATER SERVICE WITH CURB & GUTTER
 CITY OF BURLINGTON, NORTH CAROLINA
 ENGINEERING DEPARTMENT

